




E1 ELEVATION

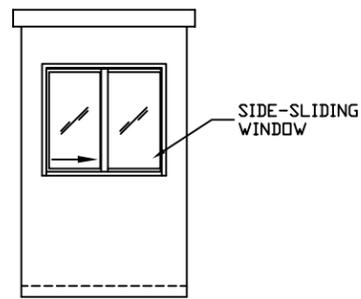


E2 ELEVATION

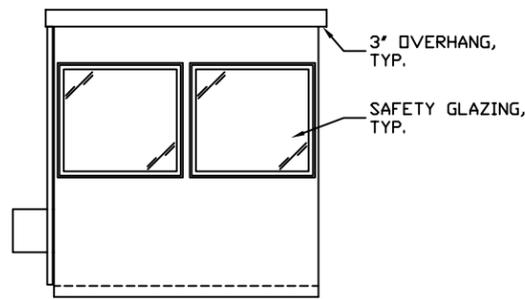


E3 ELEVATION

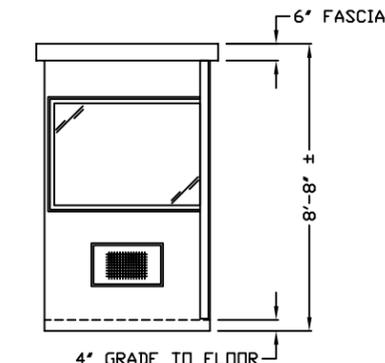

E4 ELEVATION

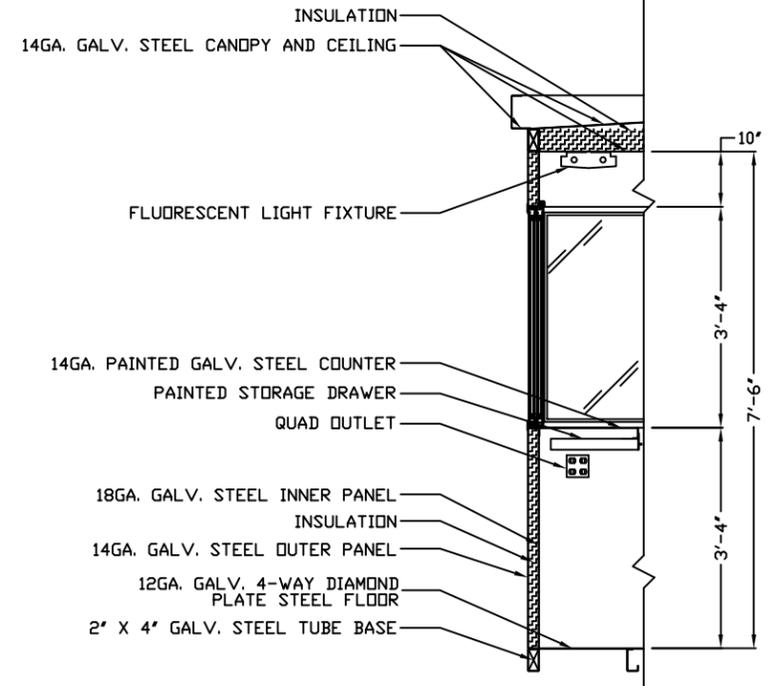

S1 SECTION
NO SCALE

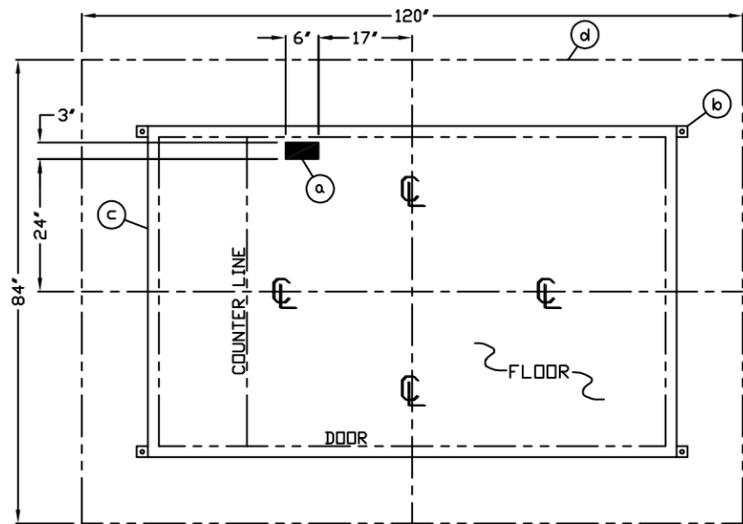


SERVICE ENTRANCE/ANCHOR BOLT LAYOUT

- a. SLOT IN FLOOR FOR ELECTRICAL SERVICE ENTRANCE TO C.B. PANEL.
- b. 2" X 2" X 1/4"(MIN) STEEL ANCHOR CLIP WITH A 3/4" ANCHOR BOLT HOLE, 4-REQ'D. ONE EACH CORNER. ANCHOR BUILDING AFTER FINAL LOCATION. ANCHOR BOLTS NOT INCLUDED.
- c. OUTER EDGE OF BUILDING.
- d. SUGGESTED MINIMUM FOUNDATION/SLAB.

GENERAL SITE INSTALLED ITEMS PROVIDED BY OTHERS

1. PROVIDE 120V/240V, SINGLE PHASE, 3-WIRE SERVICE WITH GROUND.
2. CONCRETE FOUNDATION/SLAB MINIMUM 6" DEEP, 3,000 PSI MINIMUM (28 DAY ACI 318). THE FOUNDATION/SLAB SHOULD BE A MINIMUM OF 24" WIDER THAN THE BUILDING FOOT PRINT DIMENSIONS. THIS IS TO PROVIDE A 12" CONCRETE BORDER ON EACH SIDE OF THE BUILDING.
3. ADEQUATE SIZE DRILLED ANCHOR BOLTS. SUGGESTED SIZE: 5/8" X 4 1/2" POWER FASTENERS "POWER STUD" CATALOG #7332.

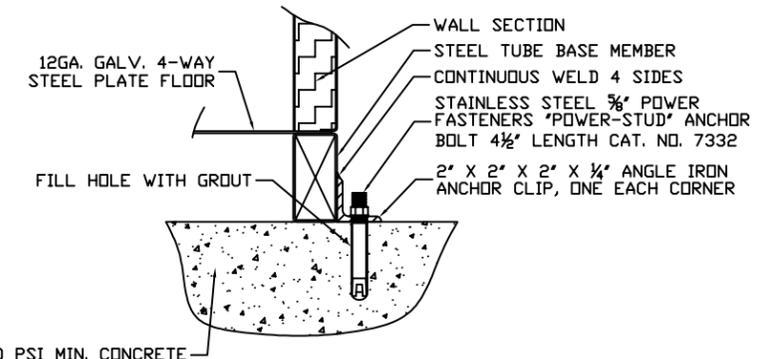

FIELD DRILLED ANCHOR BOLT DETAIL
NO SCALE

1. COUNTER - 18" DEEP PAINTED GALVANIZED STEEL MOUNTED AT SILL.
2. PAINTED STORAGE DRAWER.
3. DOOR - 36" X 80-1/4" SLIDING STEEL WITH WEATHER-STRIPPING, BALL BEARING HANGERS, HEAVY DUTY TRACK, SAFETY GLAZING, HOOK BOLT LOCK, AND HARDWARE
4. 2" DIAMETER HOLE IN COUNTER FOR DROP CORDS.
5. QUAD OUTLET MOUNTED BELOW COUNTER.
6. FLUORESCENT LIGHT - LITHONIA LB 232MVOLTGEB10IS FIXTURE WITH ACRYLIC LENS.
7. WALL SWITCH FOR INTERIOR LIGHT.
8. HVAC UNIT - GE COMBO HEAT/COOL 240V/11,600 BTU THROUGH WALL MOUNTED WITH REMOTE THERMOSTAT CONTROL.
9. SINGLE RECEPTACLE FOR HVAC UNIT.
10. CIRCUIT BREAKER PANEL - SQUARE-D #QD112M100, 120/240V, 12 SPACE, 10-3 WIRE WITH GROUND BAR AND 100 AMP MAIN BREAKER INCLUDED.
11. JUNCTION BOX MOUNTED BELOW COUNTER FOR DATA JACK PREP WITH 1/2" RACEWAY TO JUNCTION BOX ITEM #12.
12. JUNCTION BOX MOUNTED NEAR FLOOR SLOT FOR COMMUNICATIONS CONDUIT TERMINATION.
13. HORIZONTAL SIDE-SLIDING WINDOW
14. LOCATION OF STATE AND MANUFACTURERS LABELS

NOTE: PAR-KUT BOOTHS ARE OF SINGLE UNIT WELDED STEEL CONSTRUCTION, FACTORY ASSEMBLED AND DELIVERED SET UP. FAILURE TO SECURELY ANCHOR BOOTH MAY RESULT IN OVERTURNING OF UNIT AND SERIOUS INJURY TO OCCUPANT.

- A. GLAZING - TINTED, TEMPERED SAFETY GLAZING SET IN ANODIZED ALUMINUM WINDOW FRAMES. TINTED, INSULATED, TEMPERED SAFETY GLAZING IN OPERABLE WINDOW WITH PAINTED STEEL WINDOW STOPS.
- B. PAINT - FINISH SHALL BE SINGLE COLOR OF CHOICE, AXALTA IMRON POLYURETHANE HIGH GLOSS INDUSTRIAL COATING. SHALL BE APPLIED TO ALL EXPOSED METAL SURFACES. THIS EXCLUDES ROOF SURFACE, ANODIZED ALUMINUM WINDOW FRAMES AND ANY STAINLESS STEEL COMPONENTS (IF USED).
- C. ELECTRICAL - ALL WIRING BY PAR-KUT TO BE #12(MIN) STRANDED COPPER, THHN ENCLOSED IN 1/2"(MIN) E.M.T. PER NATIONAL ELECTRIC CODE. ALL ELECTRICAL EQUIPMENT WILL BE LISTED BY U.L. OR EQUIVALENT RECOGNIZED NATIONAL TESTING LABORATORY. ALL WIRING TO TERMINATE AT C.B. PANEL. ALL CIRCUITS HAVE GREEN GROUND WIRE.
- D. BOOTH WILL HAVE A 3" CANOPY OVERHANG ON ALL SIDES.
- E. LIFTING RING(S) ARE PROVIDED ON ROOF.
- F. NO ON SITE WORK BY PAR-KUT.

THIS DRAWING IS FOR REFERENCE PURPOSES ONLY. PAR-KUT BUILDINGS MUST BE SECURELY ANCHORED IN PLACE AND MUST BE PROPERLY GROUNDED. ADEQUATE SIZED ANCHOR BOLTS SHALL BE USED. THE SIZE AND DEPTH OF THE ANCHORS SHOULD BE OF SUFFICIENT DESIGN TO WITHSTAND THE HIGHEST RECORDED WIND SPEEDS/SEISMIC DESIGN CATEGORY IN THE AREA OF INSTALLATION. CONSULT A PROFESSIONAL ENGINEER FAMILIAR WITH THE WEATHER CONDITIONS IN THE AREA.

NOTE: THIS PRINT AND DESIGN ARE THE PROPERTY OF PAR-KUT INTERNATIONAL, INC. IT MUST NOT BE REPRODUCED IN ANY MANNER, NOR SHALL IT BE SUBMITTED TO OUTSIDE PARTIES FOR EXAMINATION WITHOUT OUR CONSENT. IT SHALL BE USED ONLY AS A MEANS OF REFERENCE TO WORK DESIGNED AND FURNISHED BY PAR-KUT. PAR-KUT RESERVES THE RIGHT TO MAKE CHANGES TO DESIGN FOR ENGINEERING PURPOSES WITHOUT NOTICE. REVISIONS MAY NOT BE NOTED.


PAR-KUT INTERNATIONAL, INC.
40961 Production Drive
Harrison Twp, Mich.
48045-1551
PH. (586) 468-2947
www.parkut.com



DWG#14-357 SHEET A-1
5'-0" X 8'-0" GUARD BOOTH
MODEL: 14-357

GENERAL NOTES		
PAINT COLOR: ECRU #1019		
GLAZING TINT COLOR: GRAY		
ESTIMATED WEIGHT: 2,800 LBS.		

SCALE	DRAWN BY	REVISED
NTS	DBG	
DATE	SIZE	QTY
4-2-2015	5' X 8'	1
CHK'D BY:	SALES REPRESENTATIVE	

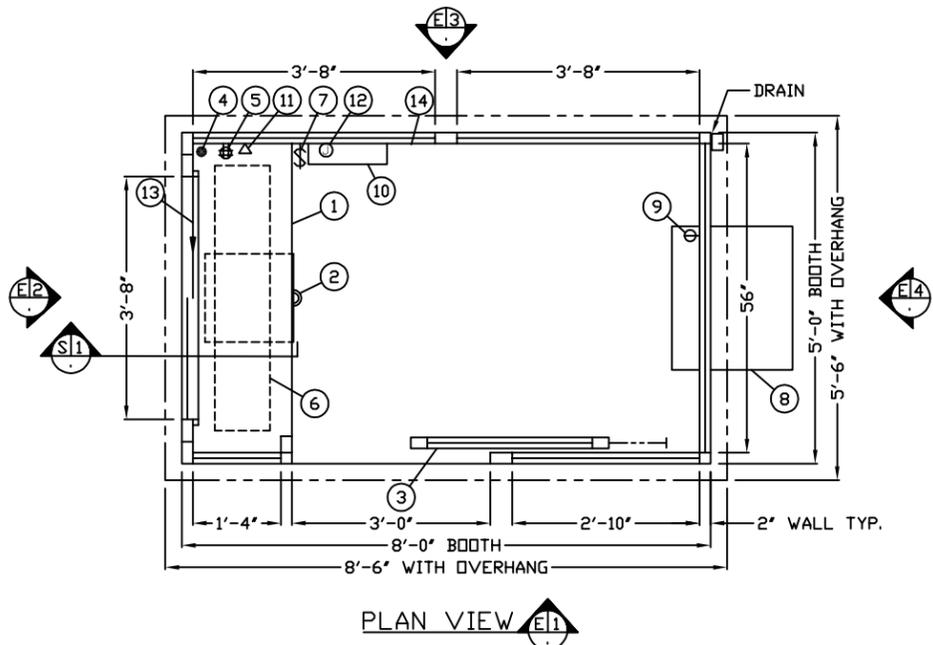

PLAN VIEW E1