



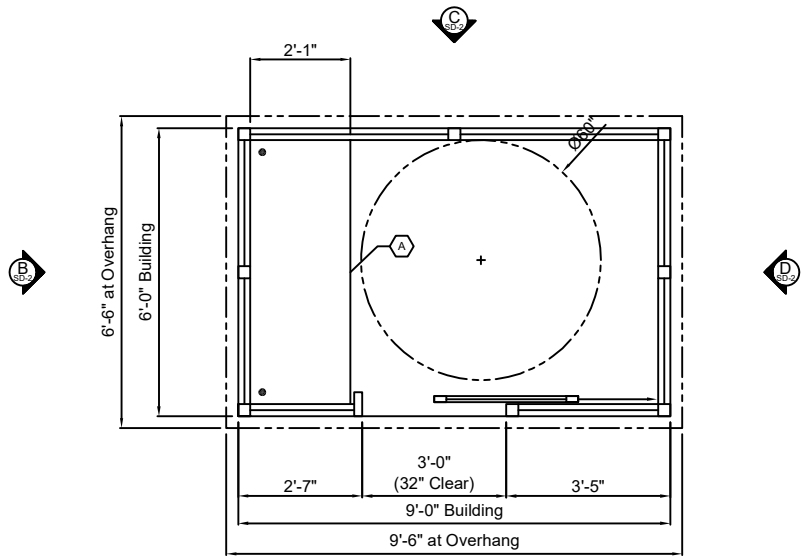

PLAN VIEW

EQUIPMENT

- A. COUNTER WITH 2" GROMMET HOLE. TOP OF COUNTER LOCATED 34" ABOVE FLOOR.
- B. SLIDING ENTRY DOOR TO PROVIDE 32" CLEAR DOOR OPENING AND INCLUDES: HOOK BOLT LOCKSET, TOP SUSPENDED CARRIERS WITH FIXED UPPER VISION LITE.

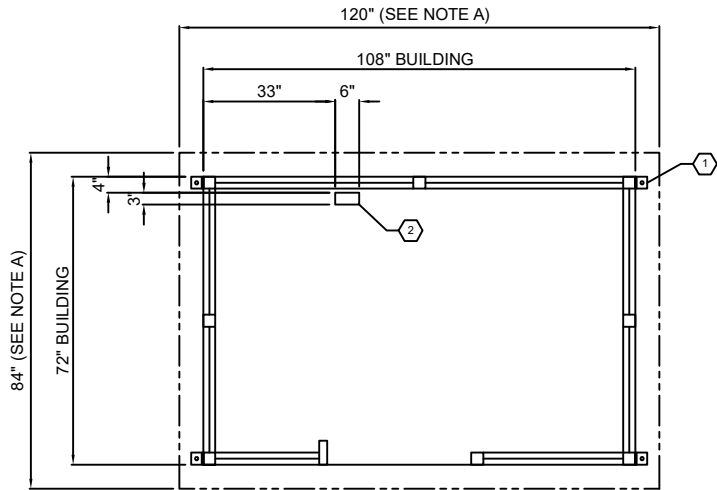

Foot Print

FLOOR ITEM IDENTIFICATION


1. ANCHORING ANGLE LOCATED AT EACH CORNER.
2. FACTORY INSTALLED CUTOUT FOR INCOMING ELECTRICAL POWER SUPPLY.

NOTE A: SUGGESTED MINIMUM CONCRETE SLAB/FOUNDATION

THIS UNIT MUST BE ANCHORED TO CONCRETE SLAB/FOUNDATION

FAILURE TO SECURELY ANCHOR BOOTH MAY RESULT IN OVERTURNING OF UNIT AND SERIOUS INJURY OR DEATH TO OCCUPANT OR TO OTHERS.

DESIGN OF SLAB/FOUNDATION BY OTHERS. CONSULT A PROFESSIONAL ENGINEER FAMILIAR WITH APPLICABLE LOADS AND SITE CONDITIONS FOR THE LOCATION.

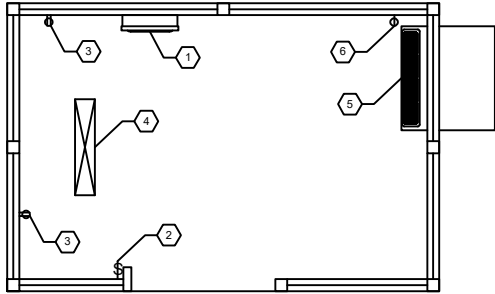

Electrical Plan


ELECTRICAL NOTES

1. 120/240 VOLT, SINGLE PHASE, 12-CIRCUIT LOAD CENTER PANEL (100 AMP. MAIN BREAKER PROVIDED). NOTE: EQUIPMENT LISTED TO BE POWERED BY 240 VOLTS CAN OPERATE ON 208-240 VOLTS POWER.
2. LIGHT SWITCH.
3. 120 VOLT, DUPLEX RECEPTACLE OUTLET.
4. SURFACE MOUNTED LED LIGHT FIXTURE.
5. 240 VOLT, 12,000 BTU COOL/10,600 BTU HEAT, 208 VOLT, 11,700 BTU COOL/8,600 BTU HEAT, HVAC UNIT WITH WIRELESS REMOTE CONTROL.
6. SINGLE RECEPTACLE 240V/20 AMP FOR HVAC POWER.

FACTORY INSTALLED COMPONENTS NOTES:

- ALL ELECTRICAL COMPONENTS TO BE LISTED BY A (NRTL) NATIONALLY RECOGNIZED TESTING LABORATORY.
- ALL WIRING PER NFPA 70, NATIONAL ELECTRICAL CODE.
- ALL FACTORY INSTALLED WIRING FOR 120/240 VOLT, BRANCH CIRCUIT, CURRENT CARRYING CONDUCTORS SHALL BE #12 MINIMUM, THERMOPLASTIC-INSULATED, THHN/THWN-2, STRANDED COPPER, RATED 600 VOLT, 90°C DRY OR WET. ENCLOSED IN SURFACE MOUNTED METALLIC RACEWAYS. EXCEPT CONTROL CIRCUIT WIRING WHICH IS SIZED PER EQUIPMENT SPECIFICATIONS/INSTALLATION REQUIREMENTS.
- ALL BRANCH CIRCUITS HAVE GREEN GROUND CONDUCTOR.
- FACTORY INSTALLED BRANCH FEEDER CONDUCTORS SHALL BE ENCLOSED IN 1/2" MINIMUM, ELECTRICAL METALLIC TUBING (EMT).
- ALTERNATIVELY, 1/2" MINIMUM 1MC/RIGID METAL CONDUIT, MC CABLE OR LIQUID TYPE METALLIC TUBING MAY BE USED. WHEN INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.

LOCATION OF DEVICE MAY VARY DUE TO MEETING CODE REQUIREMENTS AND PLACEMENT WITHIN THE STRUCTURE.

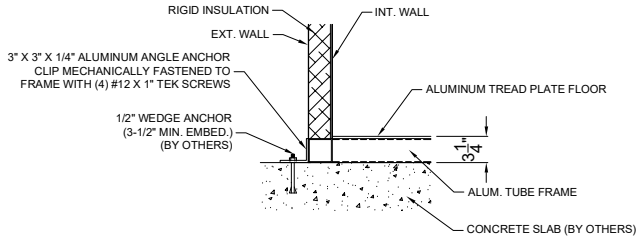

ANCHOR DETAIL

ANCHOR LOCATION AND QUANTITY PER PROJECT DRAWING FOOT PRINT/CALCULATIONS.

CONCRETE FOUNDATION/SLAB DESIGN BY OTHERS

ASSUMED DESIGN IS BASED ON A MINIMUM 6" DEEP, 3,000 PSI MINIMUM (28 DAY ACI 318) REINFORCED.

ASSUMED DESIGN SOIL BEARING COMPACTION VALUE SHALL BE A MINIMUM OF 3,000 PSF.

ASSUMED FOUNDATION/SLAB SHOULD BE A MINIMUM OF 12" WIDER THAN THE BUILDING FOOT PRINT DIMENSIONS. THIS IS TO PROVIDE A 6" CONCRETE BORDER ON EACH SIDE OF THE BUILDING.

THIS DETAIL IS FOR REFERENCE PURPOSES ONLY THE BUILDING(S) MUST BE SECURELY ANCHORED IN PLACE AND MUST BE PROPERLY GROUNDED.

ADEQUATE SIZED ANCHOR BOLTS SHALL BE USED. THE SIZE AND DEPTH OF THE ANCHORS SHOULD BE OF SUFFICIENT DESIGN TO WITHSTAND THE APPLICABLE WIND SPEED AND SEISMIC LOADS FOR THE LOCATION OF INSTALLATION AND SOIL CONDITIONS.

PLEASE CONSULT A PROFESSIONAL ENGINEER FAMILIAR WITH THESE PARAMETERS FOR THE LOCATION.

NOTE: THIS DRAWING AND DESIGN ARE THE PROPERTY OF MARDAN FABRICATION, INC. (MFI). IT MUST NOT BE REPRODUCED IN ANY MANNER, NOR SHALL IT BE SUBMITTED TO OUTSIDE PARTIES FOR EXAMINATION WITHOUT OUR CONSENT. IT SHALL BE USED ONLY AS A MEANS OF REFERENCE TO WORK DESIGNED AND FURNISHED BY MARDAN. MARDAN RESERVES THE RIGHT TO MAKE CHANGES TO DESIGN FOR ENGINEERING PURPOSES WITHOUT NOTICE. REVISIONS MAY NOT BE NOTED.

NOTE: SLIDING ADA ENTRY DOOR WILL HAVE A BOTTOM OF THE BUILDING TO THE TOP OF THE THRESHOLD MEASUREMENT OF 3-1/2"

ACCESSIBILITY NOTES:


HANDICAP ACCESSIBLE APPROACH AND EGRESS ACCESS INCLUDING A RAMP OR FOUNDATION TO BE VERIFIED AND PROVIDED BY OTHERS.

THE FOUNDATION MAY BE RECESSED OR A 1:12 RAMP MUST BE PROVIDED SO THAT MAXIMUM CHANGE IN LEVEL FROM GRADE TO FINISH FLOOR DOES NOT EXCEED 1/4".


REVIEW IN CONJUNCTION WITH SITE PLAN AND REVIEWED AGAINST APPLICABLE ACCESSIBILITY CODE FOR MORE DETAILED INFORMATION AND REQUIREMENTS.

FINISH SCHEDULE	
ITEM	DESCRIPTION
Floor	Aluminum Treadplate
Canopy	Pre-Finished White
Walls	Pre-Finished White
Ceiling	Pre-Finished White
Counter	White Plastic Laminate
Safety Glazing	Gray Tinted, Tempered, Insulated Glass


Model Number MFI-6090-SL		Approved By:	
Date: 9-9-2026	Drawing Number 26048	Drawn By: DNE	
Scale: 1/4" = 1'-0"		Revision: .	
Quick Ship Model: MFI-6090-SL TBD			
 Mardan Fabrication, Inc. 41001 Production Drive, Harrison Twp. MI 48045 Phone: 800-882-5820			Drawing Sheet SD-1

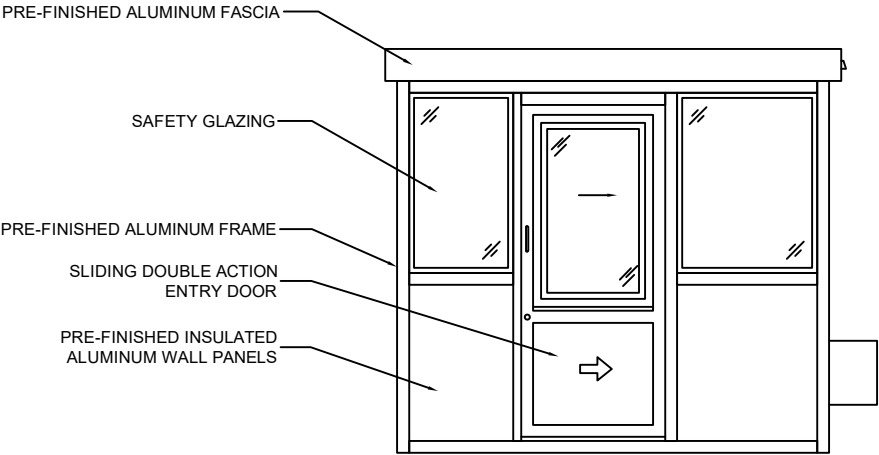


Elevation "A"

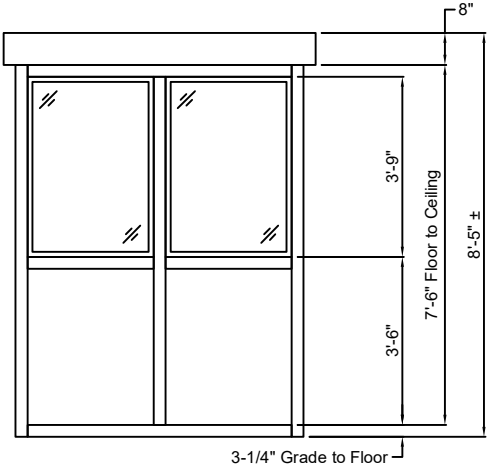

Elevation "B"

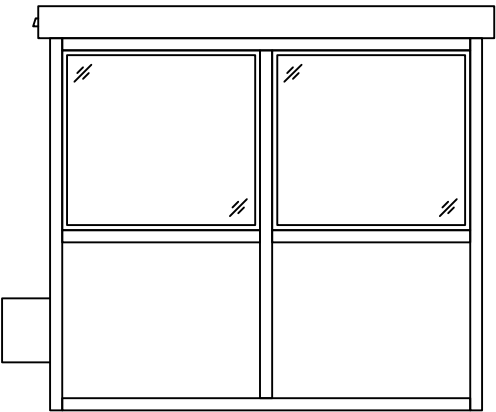

Elevation "C"

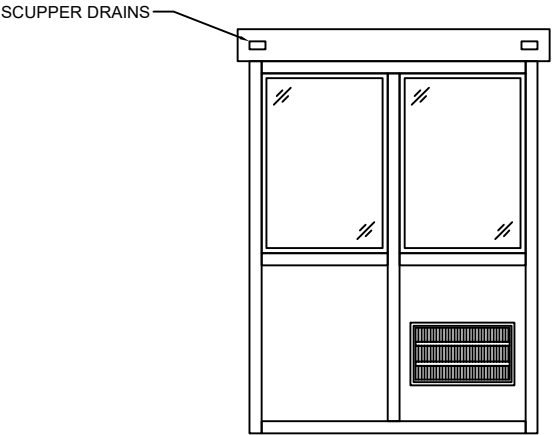

Elevation "D"

NOTE: SLIDING ADA ENTRY DOOR WILL HAVE A BOTTOM OF THE BUILDING TO THE TOP OF THE THRESHOLD MEASUREMENT OF 3'-1/2"

ACCESSIBILITY NOTES:

HANDICAP ACCESSIBLE APPROACH AND EGRESS ACCESS INCLUDING A RAMP OR FOUNDATION TO BE VERIFIED AND PROVIDED BY OTHERS.

THE FOUNDATION MAY BE RECESSED OR A 1:12 RAMP MUST BE PROVIDED SO THAT MAXIMUM CHANGE IN LEVEL FROM GRADE TO FINISH FLOOR DOES NOT EXCEED 1/4".

REVIEW IN CONJUNCTION WITH SITE PLAN AND REVIEWED AGAINST APPLICABLE ACCESSIBILITY CODE FOR MORE DETAILED INFORMATION AND REQUIREMENTS.

Model Number MFI-6090-SL		Approved By:	
Date: 9-9-2026	Drawing Number 26048	Drawn By: DNE	
Scale: 1/4" = 1'-0"		Revision: .	
Quick Ship Model: MFI-6090-SL TBD			
 Mardan Fabrication, Inc. 41001 Production Drive, Harrison Twp. MI 48045 Phone: 800-882-5820		Drawing Sheet	
		SD-2	

NOTE: THIS DRAWING AND DESIGN ARE THE PROPERTY OF MARDAN FABRICATION, INC. (MFI). IT MUST NOT BE REPRODUCED IN ANY MANNER, NOR SHALL IT BE SUBMITTED TO OUTSIDE PARTIES FOR EXAMINATION WITHOUT OUR CONSENT. IT SHALL BE USED ONLY AS A MEANS OF REFERENCE TO WORK DESIGNED AND FURNISHED BY MARDAN. MARDAN RESERVES THE RIGHT TO MAKE CHANGES TO DESIGN FOR ENGINEERING PURPOSES WITHOUT NOTICE. REVISIONS MAY NOT BE NOTED.