

THIS DRAWING IS FOR REFERENCE PURPOSES ONLY. PAR-KUT BUILDINGS MUST BE SECURELY ANCHORED IN PLACE AND ELECTRICAL SYSTEM MUST BE PROPERLY GROUNDED. ADEQUATE SIZED ANCHOR BOLTS SHALL BE USED. THE SIZE AND DEPTH OF THE ANCHORS SHOULD BE OF SUFFICIENT DESIGN TO WITHSTAND THE HIGHEST RECORDED WIND SPEEDS/SEISMIC DESIGN CATEGORY IN THE AREA OF INSTALLATION. CONSULT A PROFESSIONAL ENGINEER FAMILIAR WITH THE WEATHER CONDITIONS IN THE AREA.

GENERAL SITE INSTALLED ITEMS PROVIDED BY OTHERS	
1	PROVIDE <b>120V/240V, SINGLE PHASE, 3-WIRE</b> SERVICE WITH GROUND.
2	CONCRETE FOUNDATION MINIMUM 6" DEEP, 3,000 PSI MINIMUM (28 DAY ACI 318). THE FOUNDATION SHOULD BE A MINIMUM OF 24" WIDER THAN THE BUILDING FOOT PRINT DIMENSIONS. THIS IS TO PROVIDE A 12" CONCRETE BORDER ON EACH SIDE OF THE BUILDING.
3	ADEQUATE SIZE DRILLED ANCHOR BOLTS. SUGGESTED SIZE: 3/4" X 4 3/4" POWER FASTENERS "POWER STUD" CATALOG #7341. (1" HOLE)


**ATTENTION DESIGN REVIEWER/SITE CONTRACTOR/INSTALLER:**

VERIFICATION OF CLEARANCE IS SUGGESTED ALONG THE TRAVEL PATH OF THIS STRUCTURE TO THE FINAL ANCHORING LOCATION.

MINIMUM CLEARANCE REQUIRED IS 8'-3".

PLEASE TAKE INTO CONSIDERATION THE OVERALL LENGTH AND WIDTH OF THE STRUCTURE AS IT RELATES TO PEAKS AND VALLEYS ALONG THE TRAVEL PATH AND NOT JUST A SINGLE POINT MEASUREMENT.

GENERAL CONSTRUCTION NOTES	
PAR-KUT BOOTHS ARE OF SINGLE UNIT WELDED STEEL CONSTRUCTION, FACTORY ASSEMBLED AND DELIVERED SET UP. FAILURE TO SECURELY ANCHOR BOOTH MAY RESULT IN OVERTURNING OF UNIT AND SERIOUS INJURY TO OCCUPANT.	
<b>GLAZING - TINTED OR CLEAR (LOW-E #? INSULATED)</b> TEMPERED SAFETY GLAZING SET IN PAINTED GALVANIZED STEEL EXTERIOR WINDOW FRAMES WITH INTERIOR ALUMINUM GLAZING STOPS.	
<b>PAINT</b> - FINISH SHALL BE SINGLE COLOR OF CHOICE UNLESS OTHERWISE SPECIFIED, AXALTA IMRON POLYURETHANE INDUSTRIAL COATING. SHALL BE APPLIED TO ALL EXPOSED METAL SURFACES. THIS EXCLUDES ROOF SURFACE, ALUMINUM WINDOW FRAMES AND ANY STAINLESS STEEL COMPONENTS (IF USED).	
<b>ELECTRICAL</b> - ALL WIRING BY PAR-KUT TO BE #12(MIN) STRANDED COPPER, THHN ENCLOSED IN 1/2"(MIN) E.M.T. AND FLEXIBLE METAL CONDUIT WHERE APPLICABLE PER NATIONAL ELECTRIC CODE. ALL ELECTRICAL EQUIPMENT WILL BE LISTED BY U.L. OR EQUIVALENT RECOGNIZED NATIONAL TESTING LABORATORY. ALL WIRING TO TERMINATE AT C.B. PANEL. ALL CIRCUITS HAVE GREEN GROUND WIRE.	
BOOTH WILL HAVE A <b>NO</b> CANOPY OVERHANG ON ALL SIDES.	
<b>REMOVABLE LIFTING RING(S) ARE PROVIDED ON ROOF.</b>	
<b>LIFTING RING(S) ARE DESIGNED</b> FOR A STRAIGHT VERTICAL LIFT ONLY. SPREADER BARS MUST BE USED WHERE APPLICABLE TO ENSURE STRAIGHT VERTICAL LIFT. ALL WARRANTIES WILL BE <b>VOID</b> IF NOT LIFTED IN THIS MANNER.	
<b>NO ON SITE WORK BY PAR-KUT.</b>	
ACTUAL LOCATION OF ELECTRICAL DEVICES MAY VARY DUE TO INSTALLATION CONSTRAINTS, SHIPPING RESTRICTIONS, OR FOR PROPER PLACEMENT TO SATISFY APPLICABLE CODES.	
FLOOR PLAN MAY BE MIRRORED OR ROTATED UPON CUSTOMER REQUEST.	

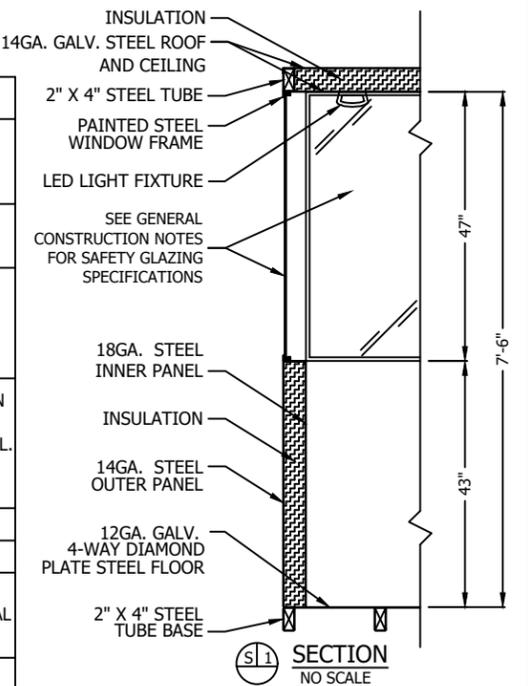


SERVICE ENTRANCE/ANCHOR BOLT LAYOUT		
ITEM	DESCRIPTION	QTY.
a	3" X 6" SLOT IN FLOOR WITH 5" X 8" REMOVABLE SCREW-DOWN ALUMINUM TREADPLATE LID, (2) SCREWS REQ'D. ONE AT EACH END, FOR ELECTRICAL SERVICE ENTRANCE TO C.B. PANEL.	1
b	3" X 3" X 3/8" (MIN) STEEL ANCHOR CLIP WITH A 1" ANCHOR BOLT HOLE, ONE EACH CORNER ANCHOR BUILDING AFTER FINAL LOCATION <b>ANCHOR BOLTS NOT INCLUDED</b>	4
c	OUTER EDGE OF BUILDING	1
d	BASE PERIMETER FRAME	1
e	INTERIOR WALL FACE	1
f	SUGGESTED MINIMUM FOUNDATION	1

LINE ITEMS		
ITEM #	DESCRIPTION	QTY
1	DOOR - <b>3068</b> SWINGING STEEL WITH WEATHER-STRIPPING, BALL BEARING BUTTS, HYDRAULIC CLOSER, SAFETY GLAZING, LEVER HANDLE LOCKSET, AND HARDWARE.	1
2	DUPLEX OUTLET MOUNTED MOUNTED <b>18" A.F.F.</b>	2
3	INTERIOR LIGHT WITH WALL SWITCH - <b>48"</b> LED LIGHT FIXTURE WITH ACRYLIC LENS.	1
4	WALL SWITCH FOR INTERIOR LIGHT.	1
5	HVAC UNIT - HEAT/COOL COMBO 240V/11,600 BTU THROUGH WALL MOUNTED WITH HANDHELD REMOTE CONTROL.	1
6	SINGLE RECEPTACLE FOR <b>HVAC UNIT.</b>	1
7	CIRCUIT BREAKER PANEL - <b>120/240V RATED (CAN BE FED WITH 120/208V), 12 SPACE, 10-3</b> WIRE WITH GROUND BAR, <b>100 AMP</b> MAIN BREAKER AND BRANCH BREAKERS FOR FACTORY INSTALLED DEVICES PROVIDED.	1

\*\*\* THIS BOOTH IS DESIGNED FOR INTERIOR/SHELTERED USE AND NOT INTENDED FOR PERMANENT EXPOSURE TO PRECIPITATION.\*\*\*

GENERAL NOTES & COLORS	
HIGH GLOSS PAINT COLOR:	_____
GLAZING TINT COLOR:	_____ (PLEASE SPECIFY COLORS)
SHIPPING NOTES	
OVERALL SHIPPING DIMENSIONS:	8'-0"W X 10'-10"L X 8'-2"H±
ESTIMATED WEIGHT:	3,600 LBS. ±
SOME ITEMS MAY BE SHIPPED LOOSE TO MEET SHIPPING CONSTRAINTS. <b>DRAIN DOWNSPOUTS ARE SHIPPED LOOSE AND INSTALLED ON SITE BY OTHERS.</b>	

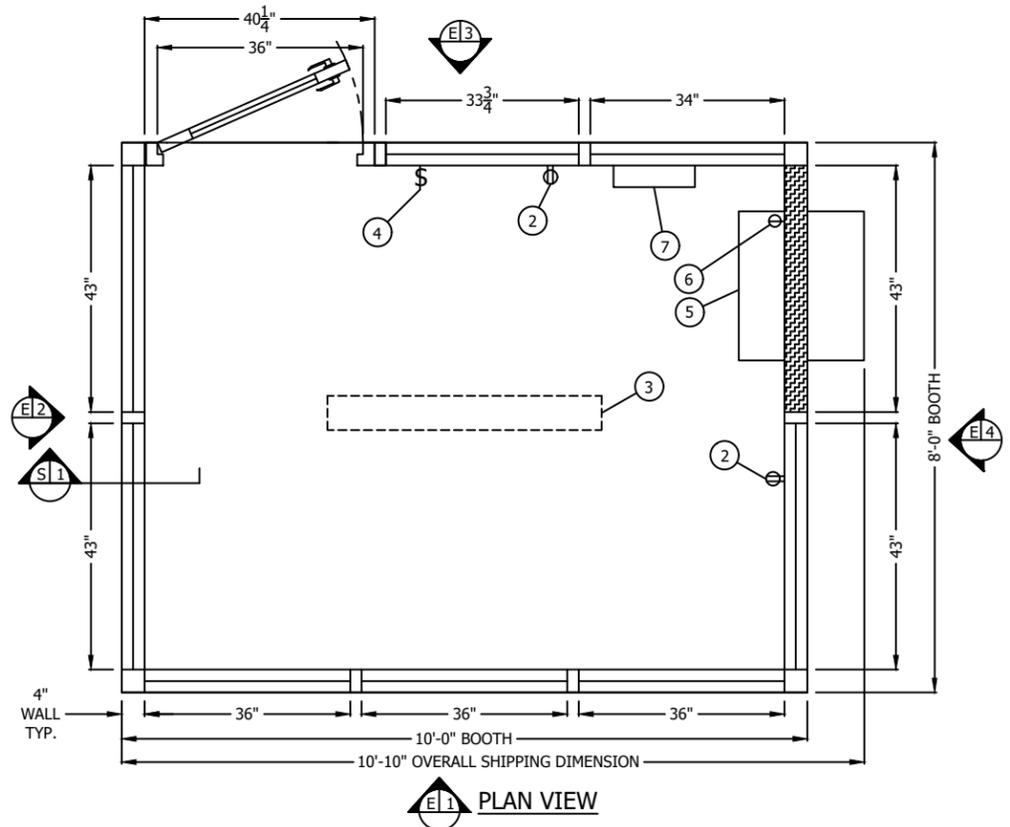

NOTE: THIS PRINT AND DESIGN ARE THE PROPERTY OF PAR-KUT INTERNATIONAL, INC. IT MUST NOT BE REPRODUCED IN ANY MANNER, NOR SHALL IT BE SUBMITTED TO OUTSIDE PARTIES FOR EXAMINATION WITHOUT OUR CONSENT. IT SHALL BE USED ONLY AS A MEANS OF REFERENCE TO WORK DESIGNED AND FURNISHED BY PAR-KUT. PAR-KUT RESERVES THE RIGHT TO MAKE CHANGES TO DESIGN FOR ENGINEERING PURPOSES WITHOUT NOTICE. REVISIONS MAY NOT BE NOTED.

PAR-KUT INTERNATIONAL, INC.  
40961 Production Drive  
Harrison Twp., Mich.  
48045-1351  
PH. (586) 468-2947  
www.parkut.com

DWG# PK108ip SHEET A-1

STANDARD 8' X 10'  
IN-PLANT OFFICE BOOTH  
MODEL 1081P

PO# \_\_\_\_\_  
SCALE 3/8"=12" DRAWN BY DPH REVISED 12-07-2023  
DATE 1-10-2017 SIZE 8' X 10' QTY 1  
CHK'D BY: \_\_\_\_\_ SALES REPRESENTATIVE